


Huntsville Utilities Electric Department Tree Clearance Standards

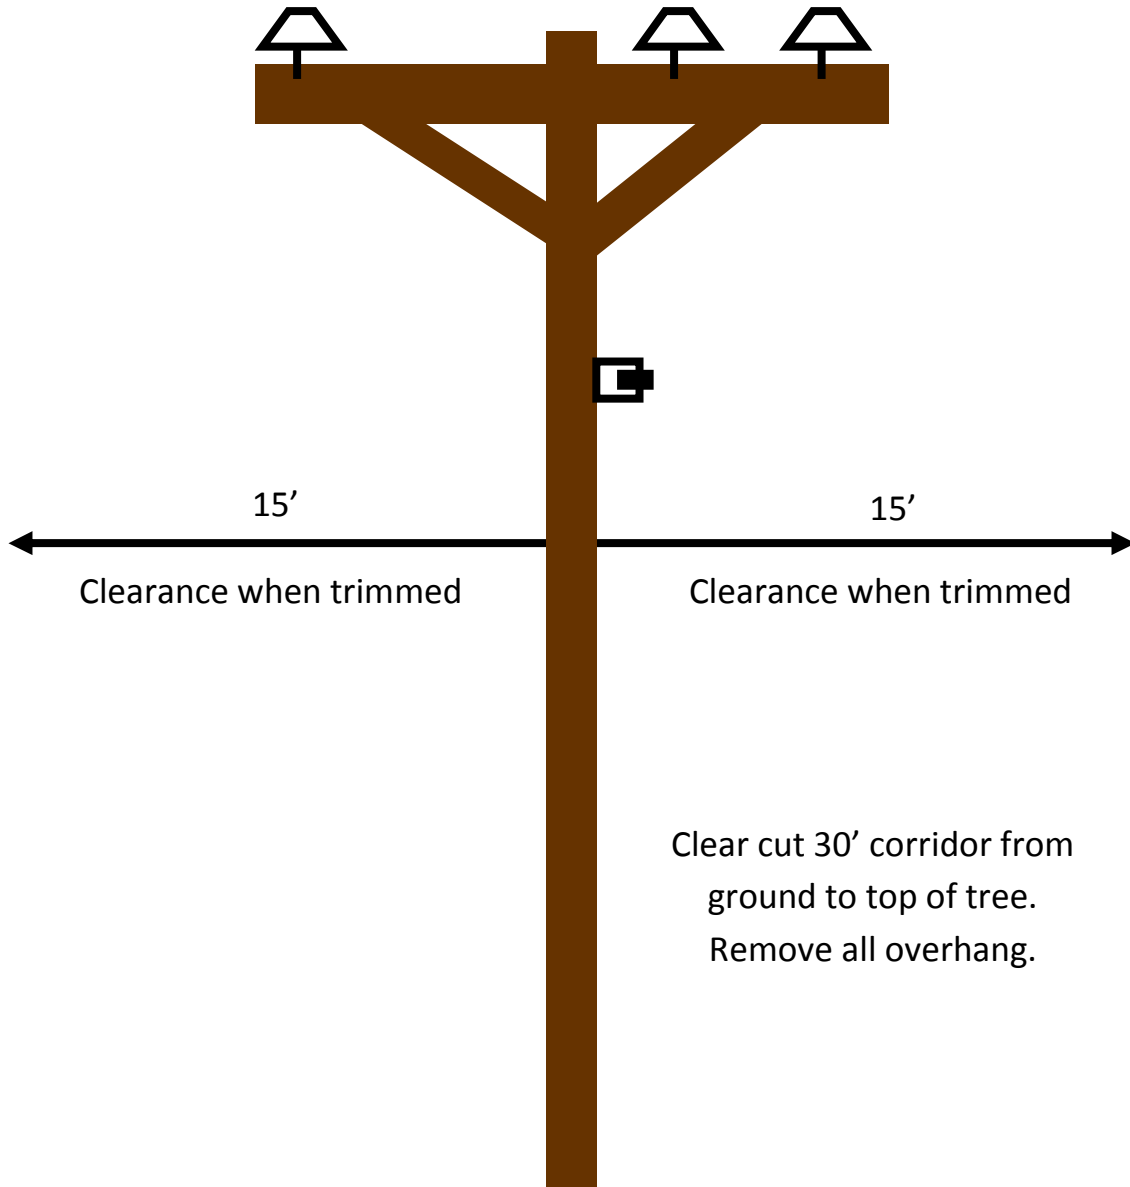

1. All new overhead primary lines must have an initial tree clearance of fifteen feet on either side of the line, with no growth, or overhang allowed inside the 30-foot corridor.
2. The customer is responsible for providing the initial clearance for new construction.
3. New lines will not be energized until the initial clearance is provided.
4. Huntsville Utilities will maintain the tree trimming on primary and secondary, but not services once the line is energized.